


**CURB AND GUTTER**

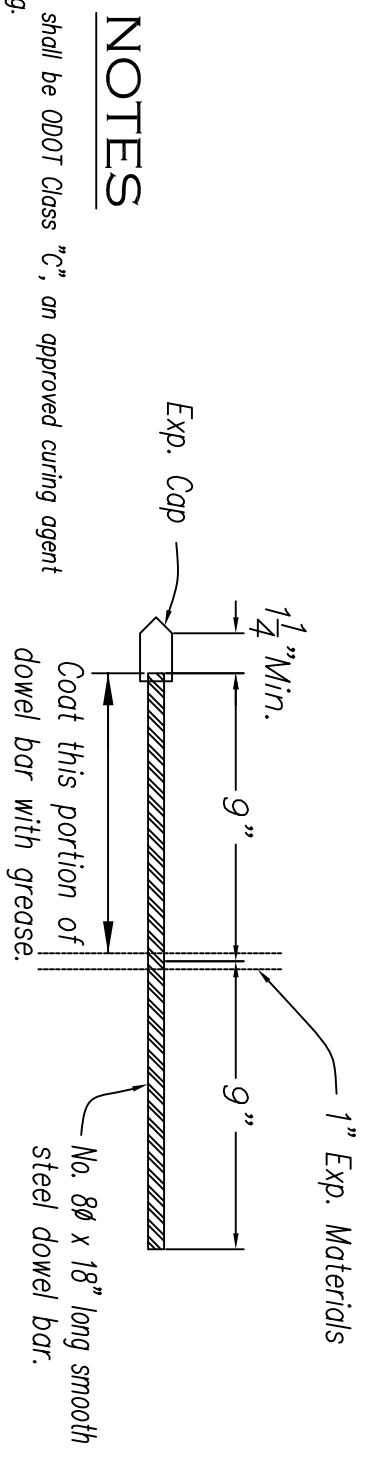

**DOWEL BAR DETAIL**

**NOTES**

- (1) Concrete for curbs and gutters shall be ODOT Class "C", an approved curing agent shall be applied after finishing.
- (2) Two smooth steel dowel bars, No. 8, x 18 inches long, with expansion caps shall be installed at each expansion joint as shown on the detail.
- (5) All joints shall be vertical and either perpendicular or radial to the back of the curb.
- (6) All exposed edges shall be rounded to 1/2" radius.
- (7) All curbing shall be backfilled before pavement work is begun.
- (8) Requirements as shown with expansion joints at radii and inlets, impressed contraction joints at 10' spacing between expansion joints.
- (9) See ODOT Standard Construction Drawing BP2.2 for additional details.

**STANDARD CURB**

**STD0005**